



P/N 51999-07  
MODEL MAS25



Balboa Instruments  
Incorporated  
BALBOA INSTRUMENTS INC.  
TUSTIN, CA.



LISTED  
74254  
US

Certified to comply with  
the limits for a class B  
computing device pursuant  
to support J of part 15  
of the FCC rules

60 HZ

MODEL: WH-MAS25-CCAJ


PAT. NO. 4618797

USE COPPER  
CONDUCTOR  
ONLY  
#18 AWG MIN.  
WIRE = 90°C

EMPLOYER  
UNIQUEMENT  
DES  
CONDUCTEURS  
DE CUIVRE.

TOURQUE RANGE  
FOR TB1:  
16-18 IN. LBS

FOR SUPPLY CONNECTIONS, USE CONDUCTORS  
SIZED ON THE BASIS OF 60°C AMPACITY BUT  
RATED MINIMUM OF 90°C.

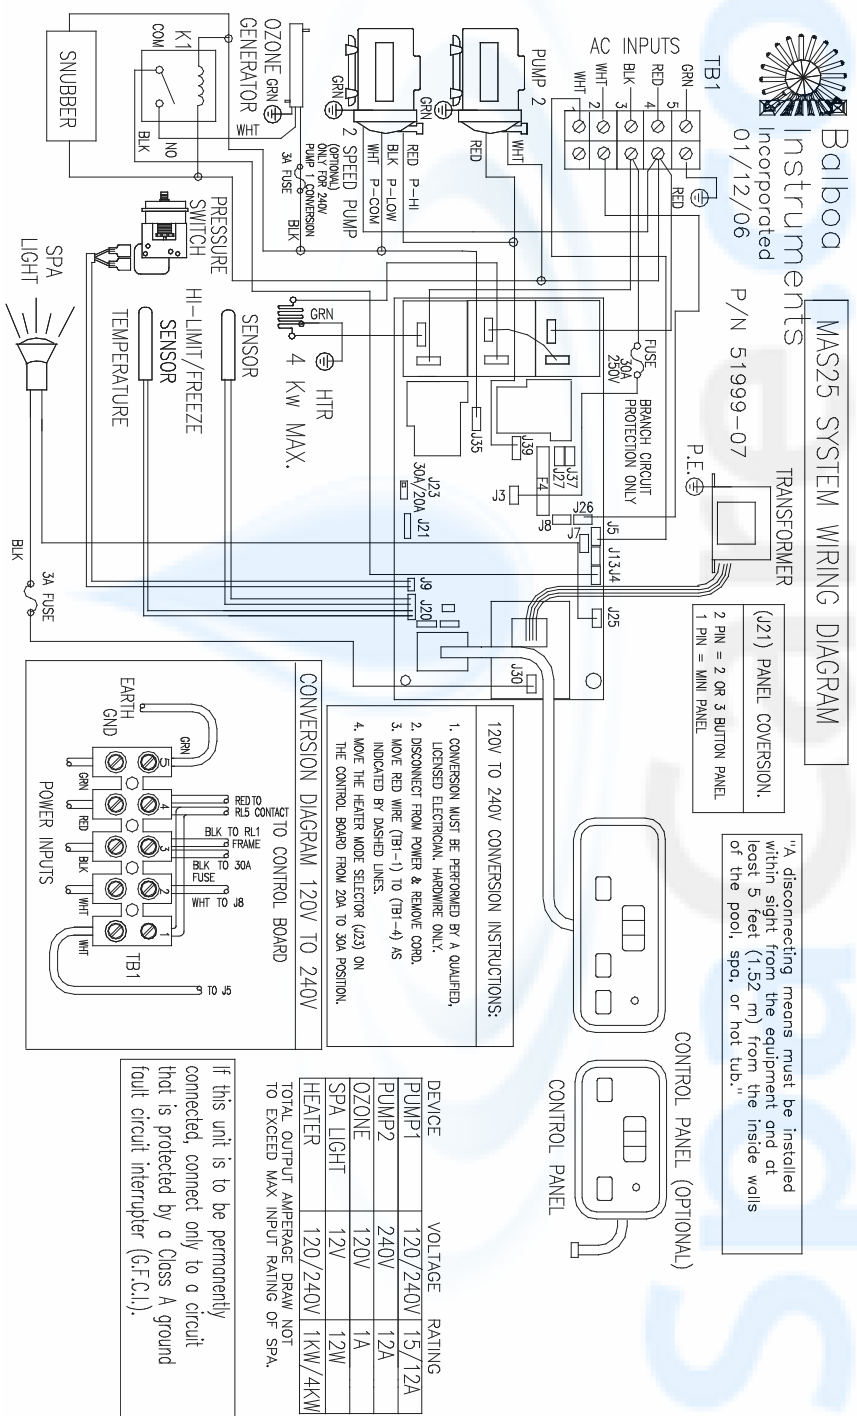

Balboa Instruments  
P/N 51999-07  
01/12/06

MAS25 SYSTEM WIRING DIAGRAM

"A disconnecting means must be installed within sight from the equipment and at least 5 feet (1.52 m) from the inside walls of the pool, spa, or hot tub."

If this unit is to be permanently connected, connect only to a circuit that is protected by a Class A ground fault circuit interrupter (G.F.C.I.).